



Measurement Report

Conducted by the
National and Kapodistrian University of Athens
Physics Department

According to the contract, signed between the **Institute of Accelerating Systems and Applications of National and Kapodistrian University of Athens** and **MARIS POLYMERS SA**, on 28/09/2020, measurements for the assessment of the:

- **solar reflectance (SR)** at the UV-VIS-NIR spectrum (300 to 2500nm),
- **infrared emittance** at the wide IR spectrum

have been carried out by the laboratory of the Group Building Environmental Studies, of the Physics Department, of the National and Kapodistrian University of Athens (NKUA).

The following specimens have been submitted for testing:


Specimen 1: Sample of white color paint and dimensions: 7 cm x 7 cm.

Product Code: Mariseal 400 White

The laboratory of the Group Building Environmental Studies, of the Physics Department of NKUA hereby reports that on the 28/09/2020 the above mentioned tested samples have been successfully measured to have the values of solar reflectance and infrared emittance that are shown in Table 1 and Table 2.

Product Description	Sample's photograph	SR	SRuv	SRvis	SRnir
Mariseal 400 White		85	7	94	84

Table 1. The values of solar reflectance of the sample submitted

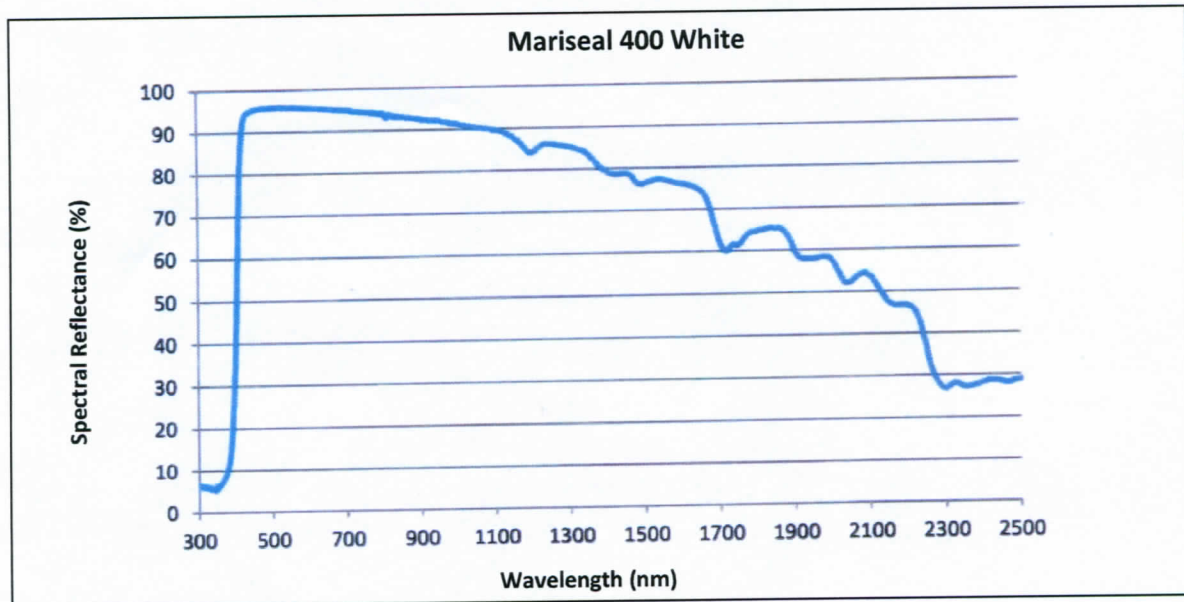

National and Kapodistrian University of Athens, Physics Department, Section of Environmental Physics & Meteorology, Group Building Environmental Studies

Building of Physics no 5, University Campus
157 84 Athens, Greece

Tel: +30 210 72 76 847 Fax: +30 210 72 95 282
masim@phys.uoa.gr <http://groupbuildingresearch.gr>



Product Description	Infrared Emittance ($\epsilon \pm 0,02$)
Mariseal 400 White	0,89

Table 2. The values of infrared emittance of the sample submitted

Product Description	Solar Reflectance Index (SRI)
Mariseal 400 White	107

Table 3. The values of Solar Reflectance Index of the sample submitted

The measurements for the solar reflectance were conducted according to the ASTM Standard E903-12 and ASTM standard G159-98, by using a UV/VIS/NIR (Varian, Carry 5000) fitted with a 150mm diameter, integrating sphere (Labsphere, DRA 2500). The reference standard reflectance material used for the measurement was a PTFE plate (Labsphere).

The measurements for the infrared emittance were conducted according to the ASTM Standard C1371-04a, by using the Emissometer Model AE (Devices & Services).

The calculation for the solar reflectance index was performed according to the ASTM standard E1980-01.

Associate Professor:

M.N. Assimakopoulou

02/10/2020

Signed on:

